



## NIMBUS FLEX S NET

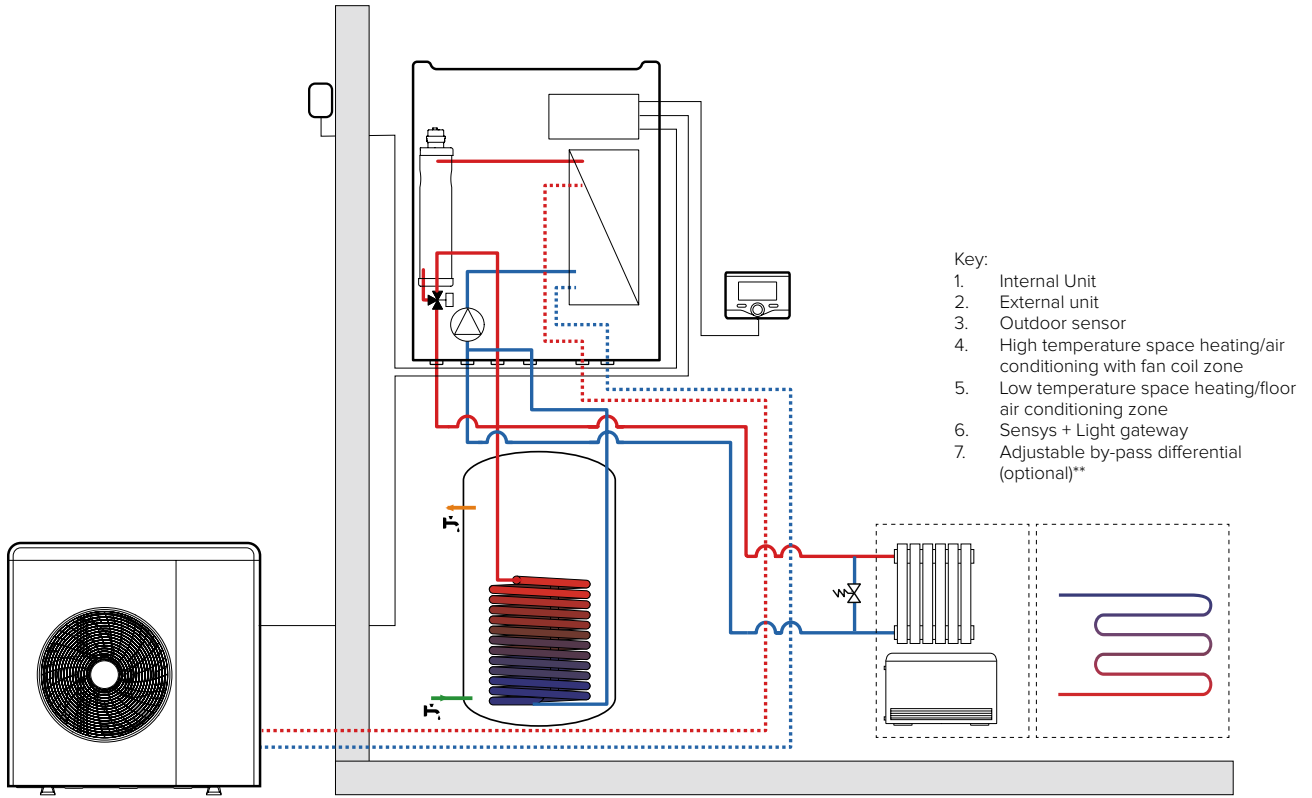

## NIMBUS FLEX S NET + 2 ZONE HOT/COLD CONTROL KIT

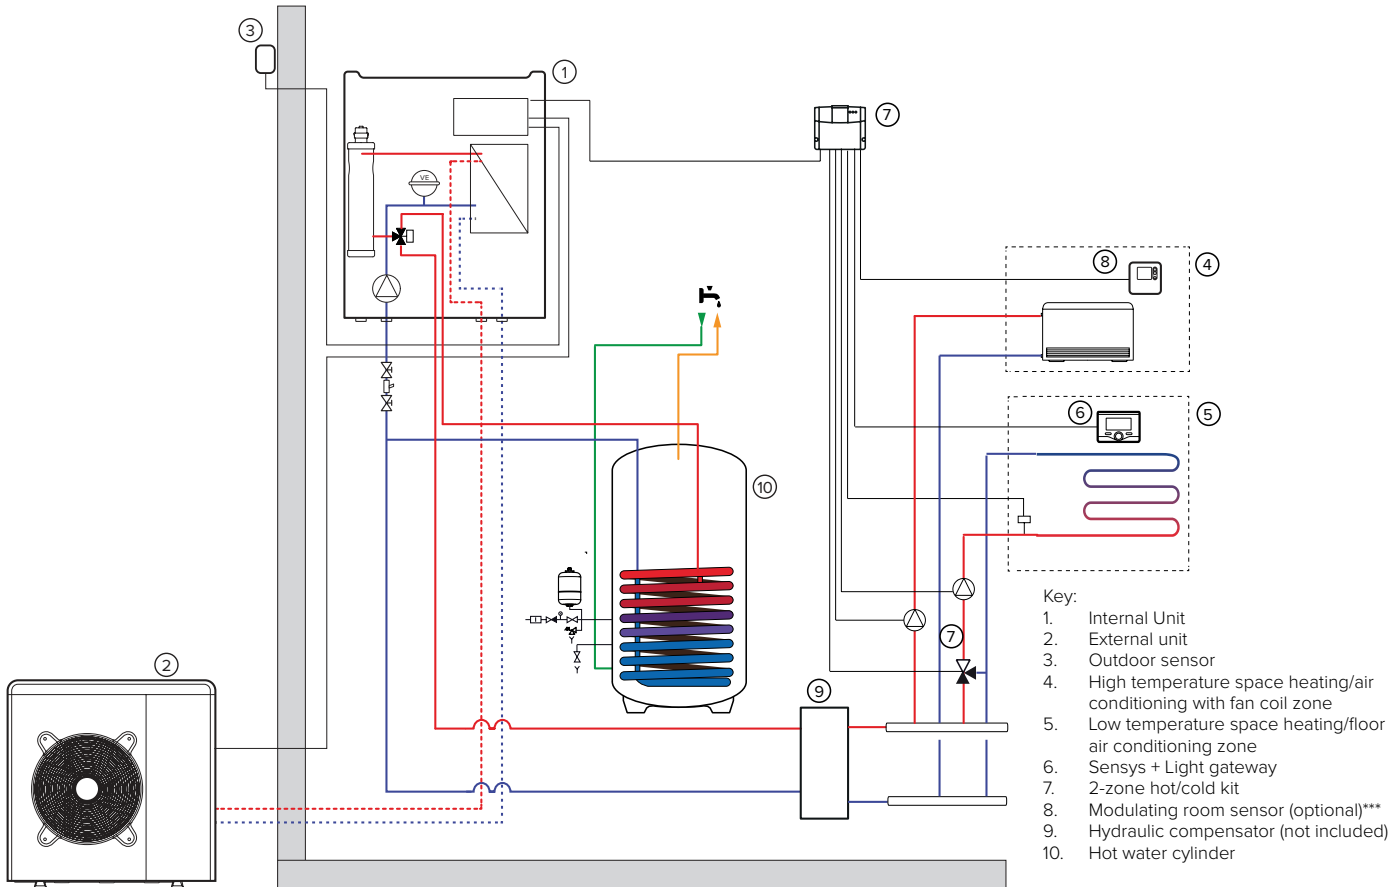

\*\*\* to manage the second zone via ARISTON NET, an additional Sensys must be installed instead of the modulating room sensor.